


2009 Well Testing Results Arsenic

- > 0.010 ppm* (12 wells)
- 0.005 - 0.010 ppm (30 wells)
- < 0.005 ppm (85 wells)
- Not Detected (40 wells)
- Not Tested for this Contaminant (170 wells)

 Rio Grande Watershed

* EPA's Maximum Contaminant Level for safe drinking water

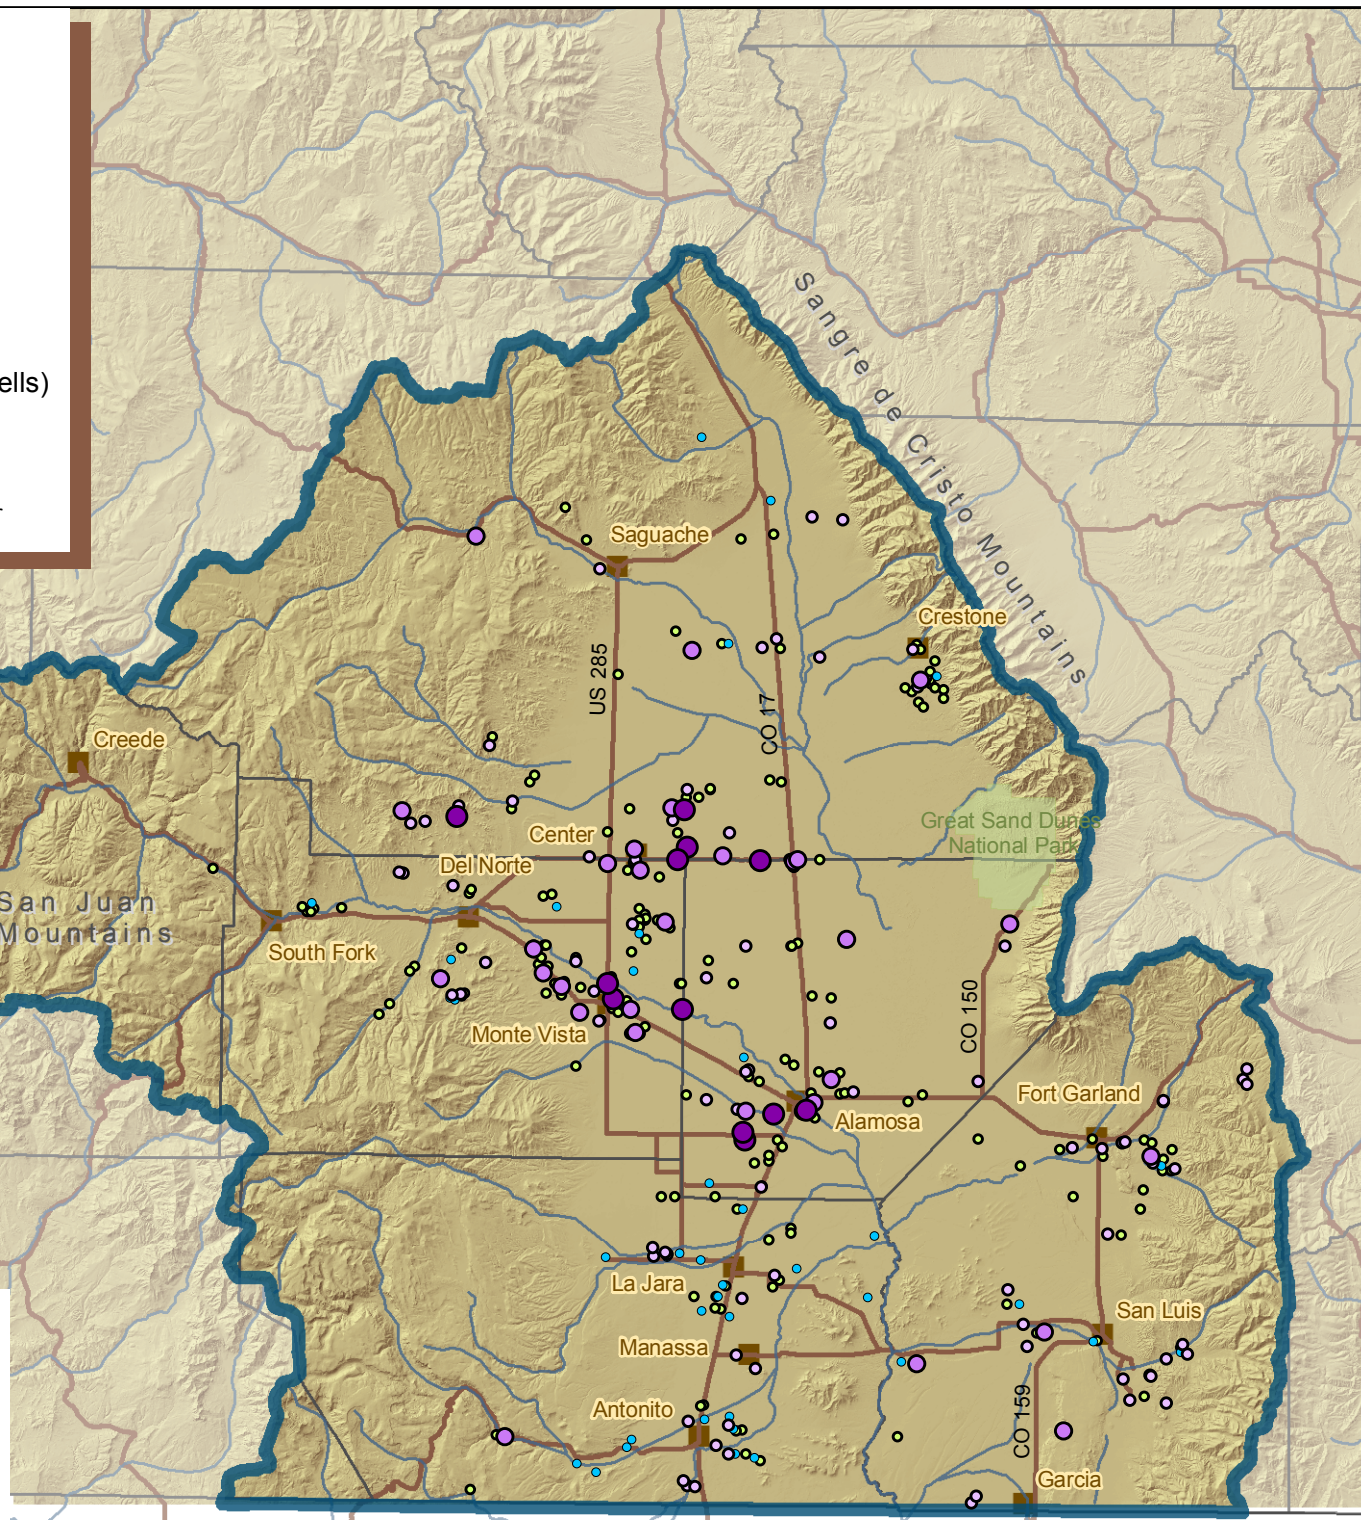

Colorado
State
University



This map has been funded in whole or partly through the U.S. Environmental Protection Agency (EPA)'s Technical Assistance Services for Communities (TASC) program and the San Luis Valley Ecosystem Council (SLVEC). Its contents do not necessarily reflect EPA's policies, actions or positions.